




Unit Coolers **TA Kit E1K**

Notice originale
Original notice
Originale Hinweise

N° IN6B00611
05.2003

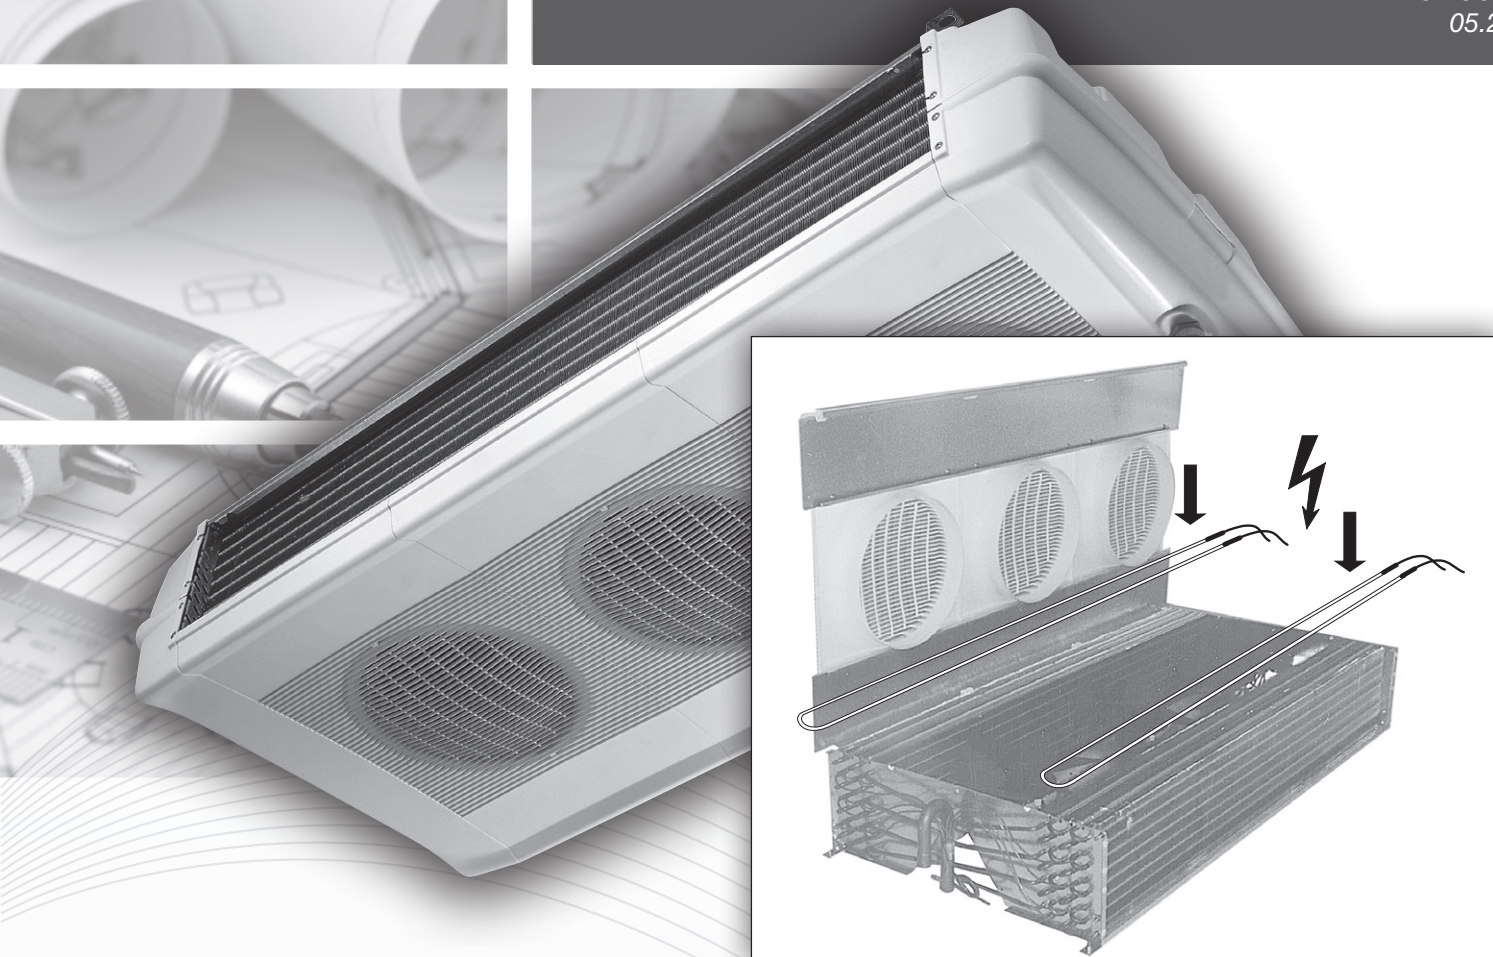

NOTICE TECHNIQUE D'INSTALLATION INSTALLATION INSTRUCTIONS INSTALLATIONSNOTIZ


FRIGA-BOHN




HK REFRIGERATION



1. POSITIONNEMENT DES RESISTANCES HEATER LOCATIONS POSITIONIERUNG DER HEIZSTÄBE




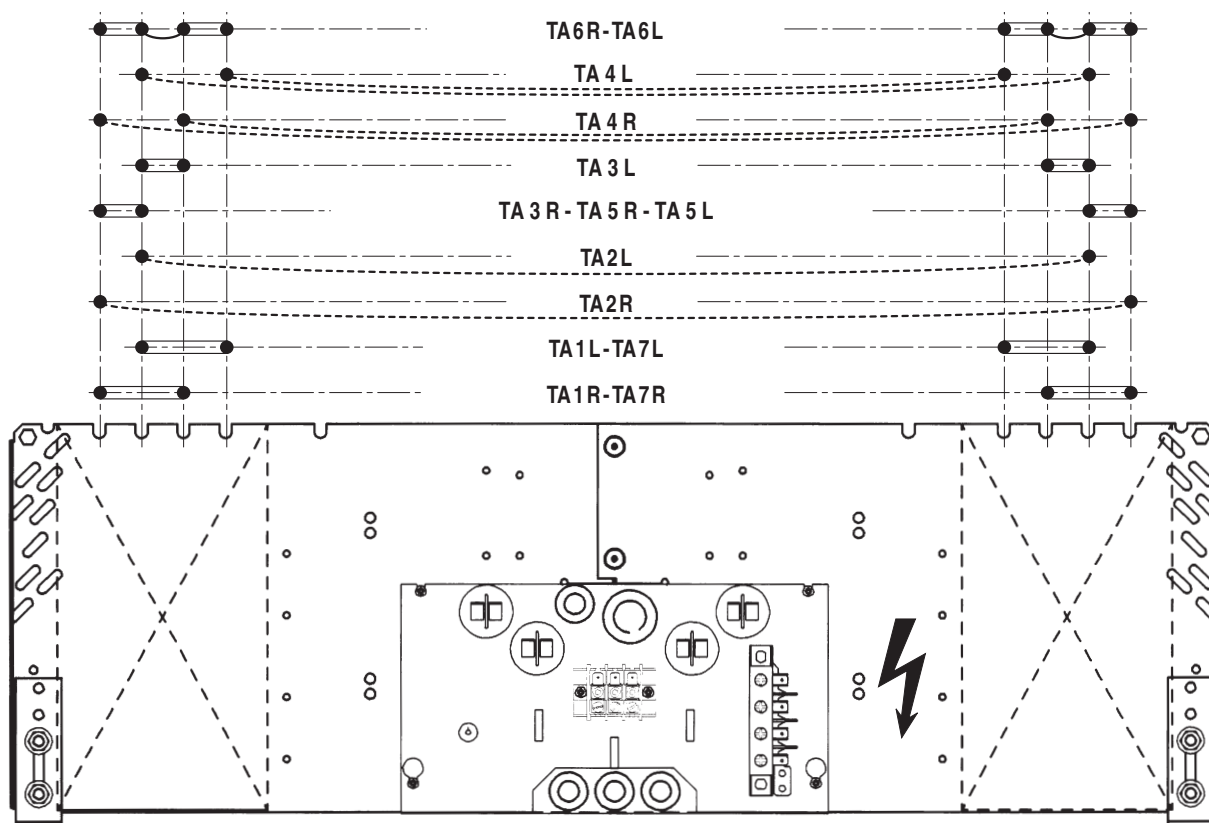


2. MONTAGE DES RESISTANCES HEATERS MOUNTING EINBAU DER HEIZUNG

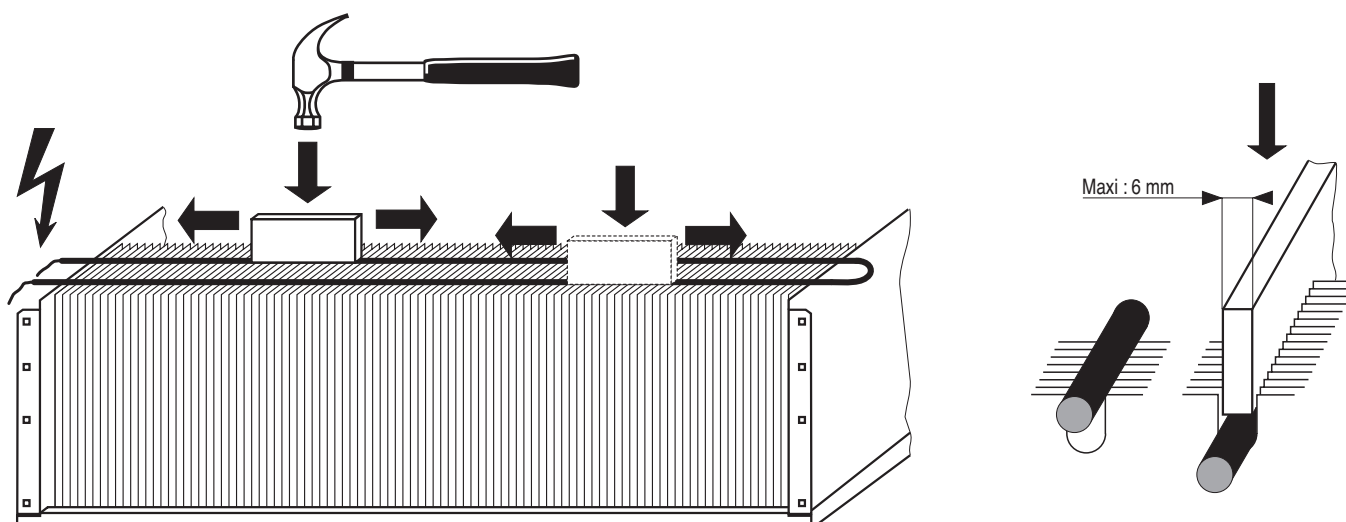

3. POSITIONNEMENT ET MONTAGE DES CLIPS CLIPS LOCATION AND MOUNTING POSITIONIERUNG UND EINBAU DER CLIPS


① → ② → ③

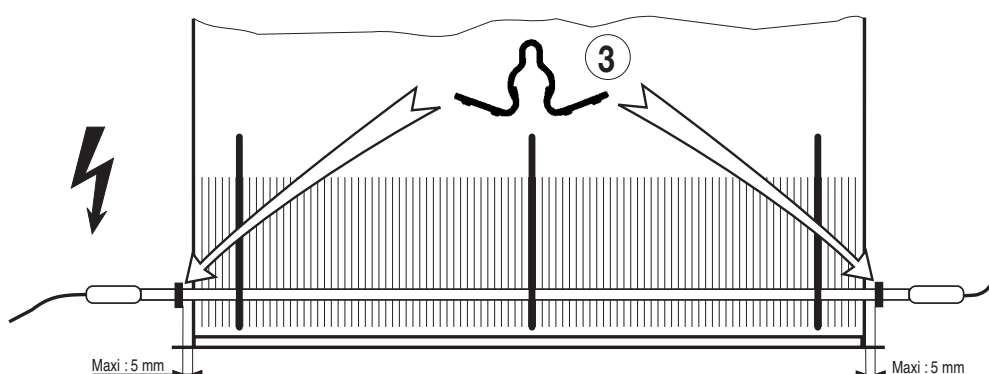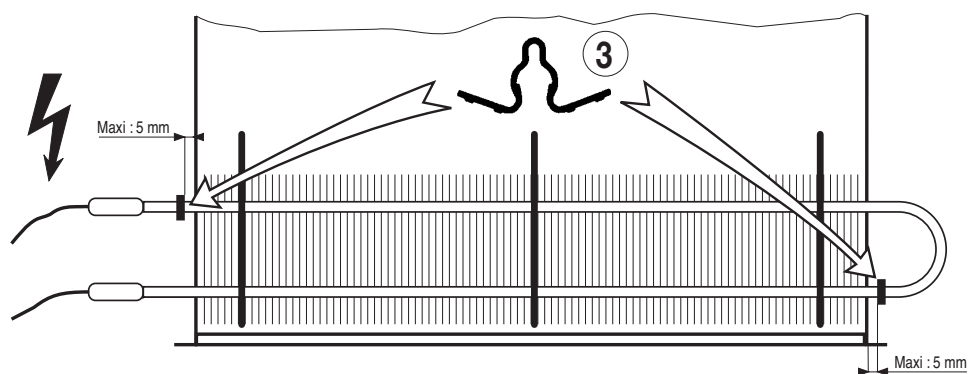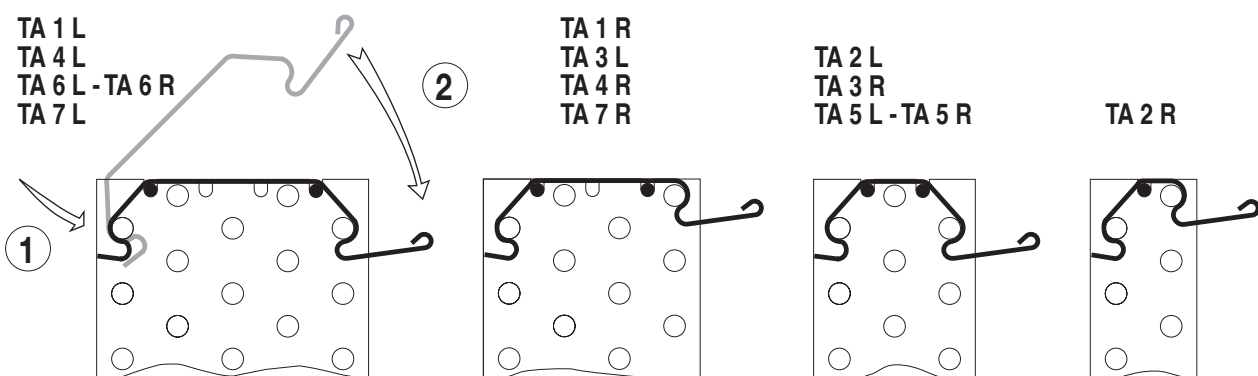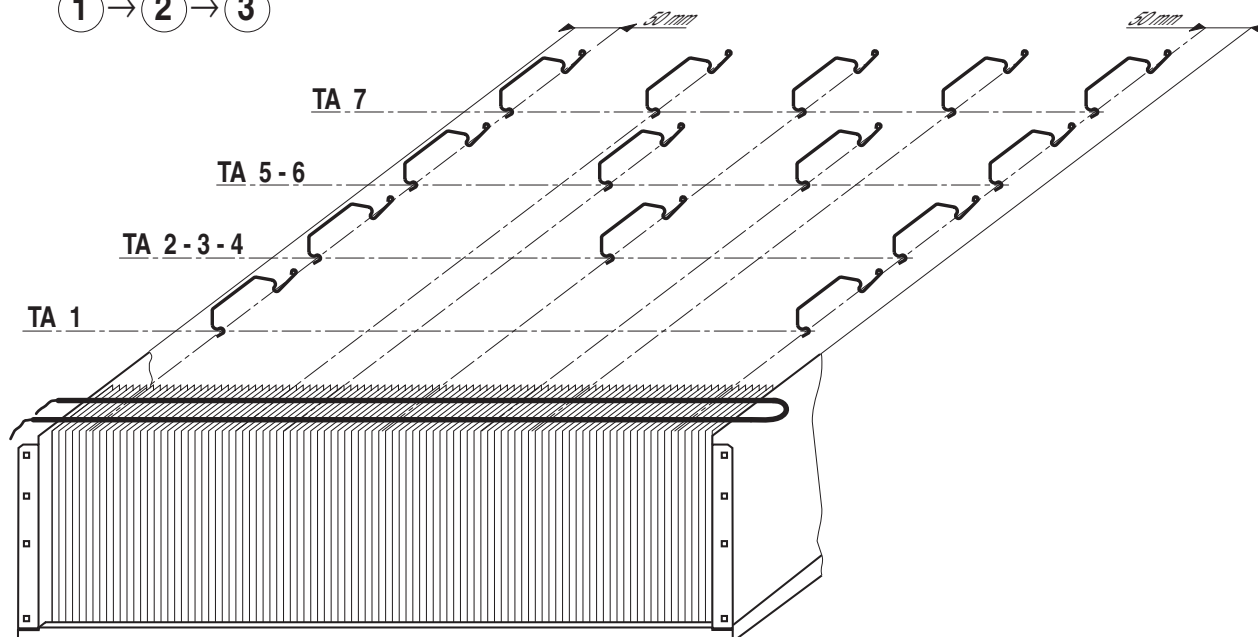

4. MONTAGE BORNIER

TERMINAL BLOCK MOUNTING

EINBAU DES ANSCHLUSSLEITE

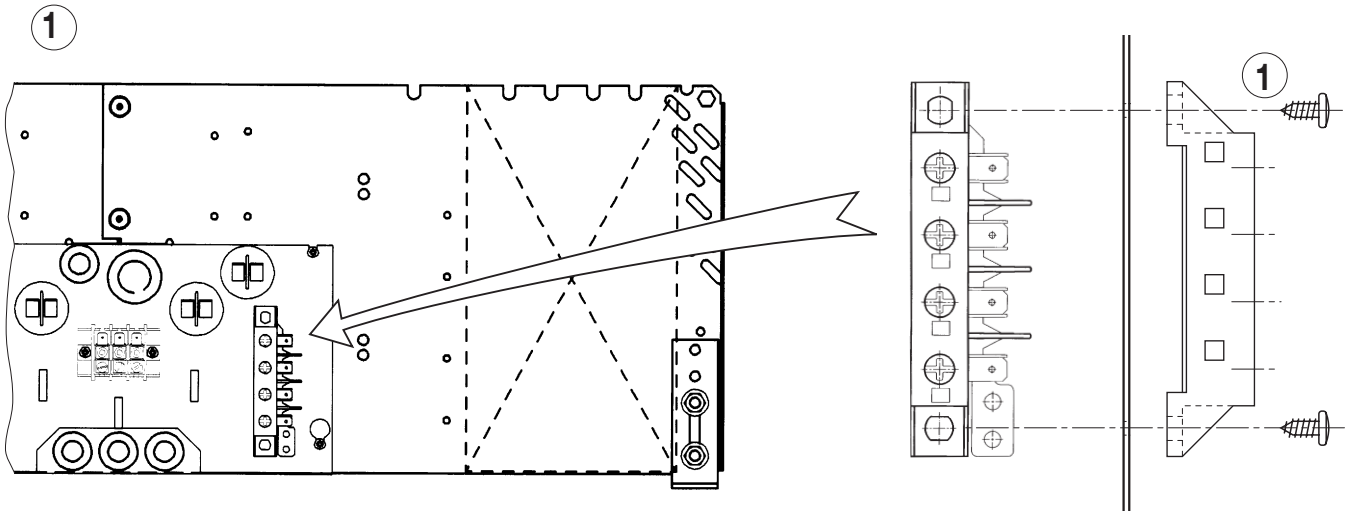

5. RACCORDEMENT DES RESISTANCES


DEFROST HEATER CONNECTION

ANSCHLÜSS DER HEIZSTÄBE


1 → 2

Modèles Models Modelle	TA ...			1	2	3	4	5	6	7
Dégivrage électrique Electric defrost Elektrische Abtaung	230 V/1	Total	W	800	800	1200	1600	1800	3000	3200
		Total	A	3,5	3,5	5,2	7,0	7,8	13,0	14,0
	400 V/3 + N	Total	W						3000	3200
		Total	A						6,5	6,9

1

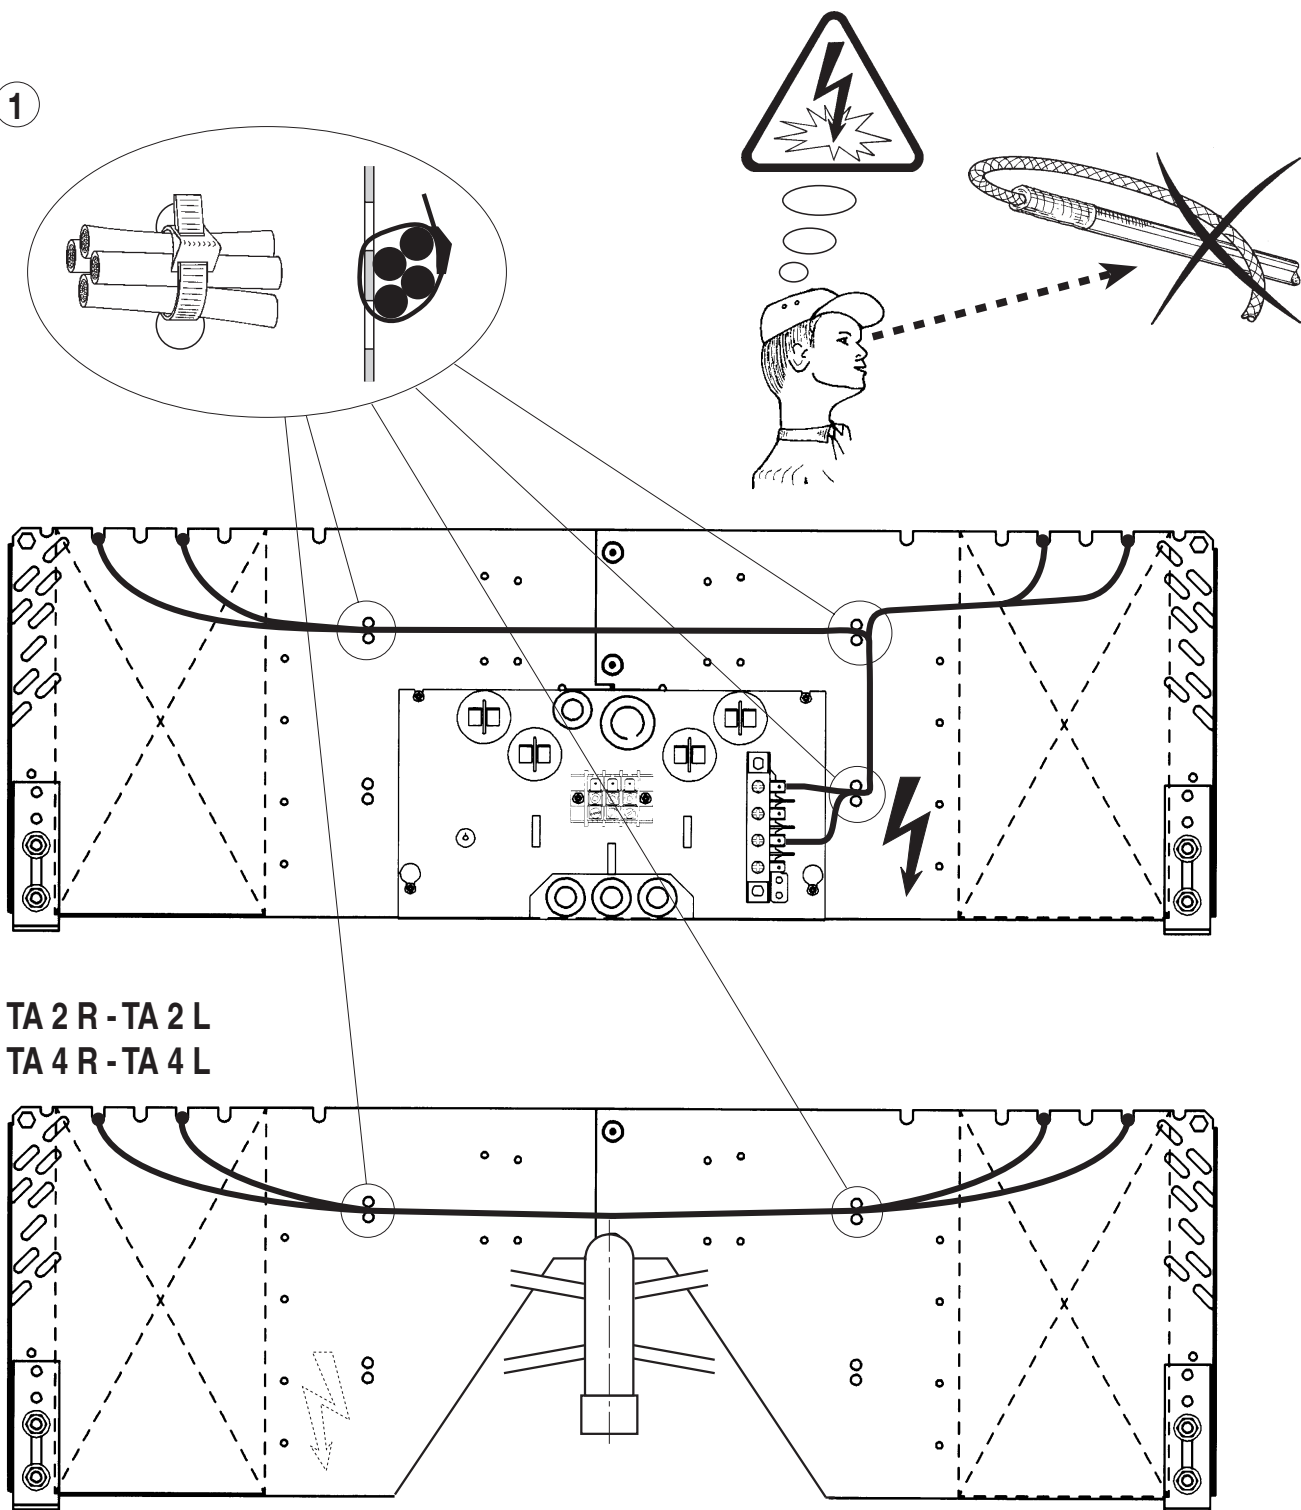

2

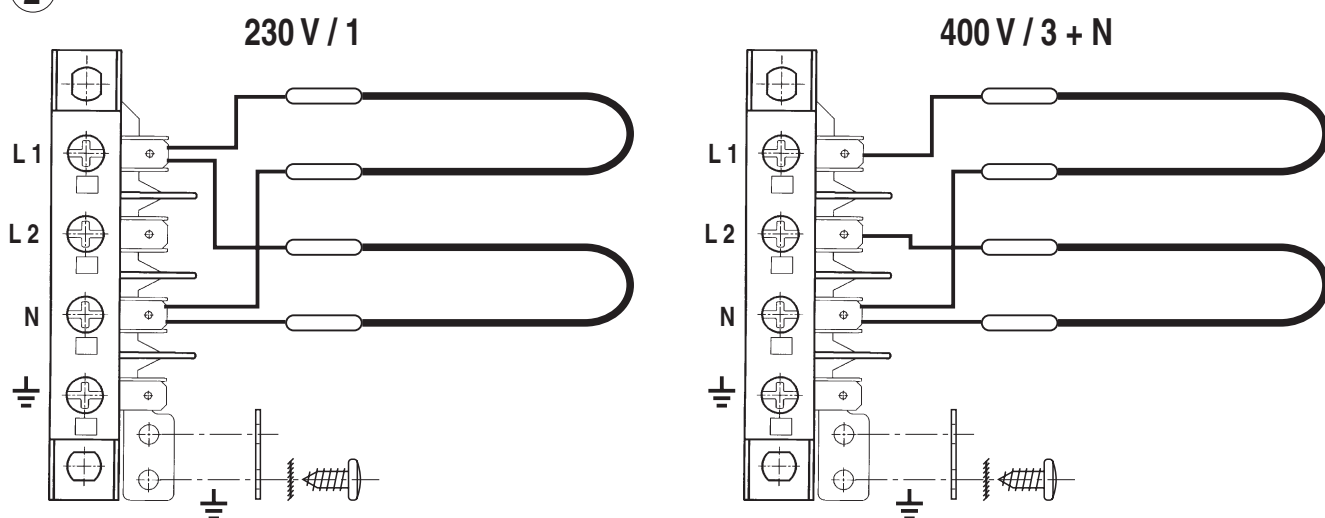

6. RACCORDEMENT ELECTRIQUE ELECTRIC CONNECTION ELEKTRISCHER ANSCHLUSS

